


DATE: JAN 2002

NEW

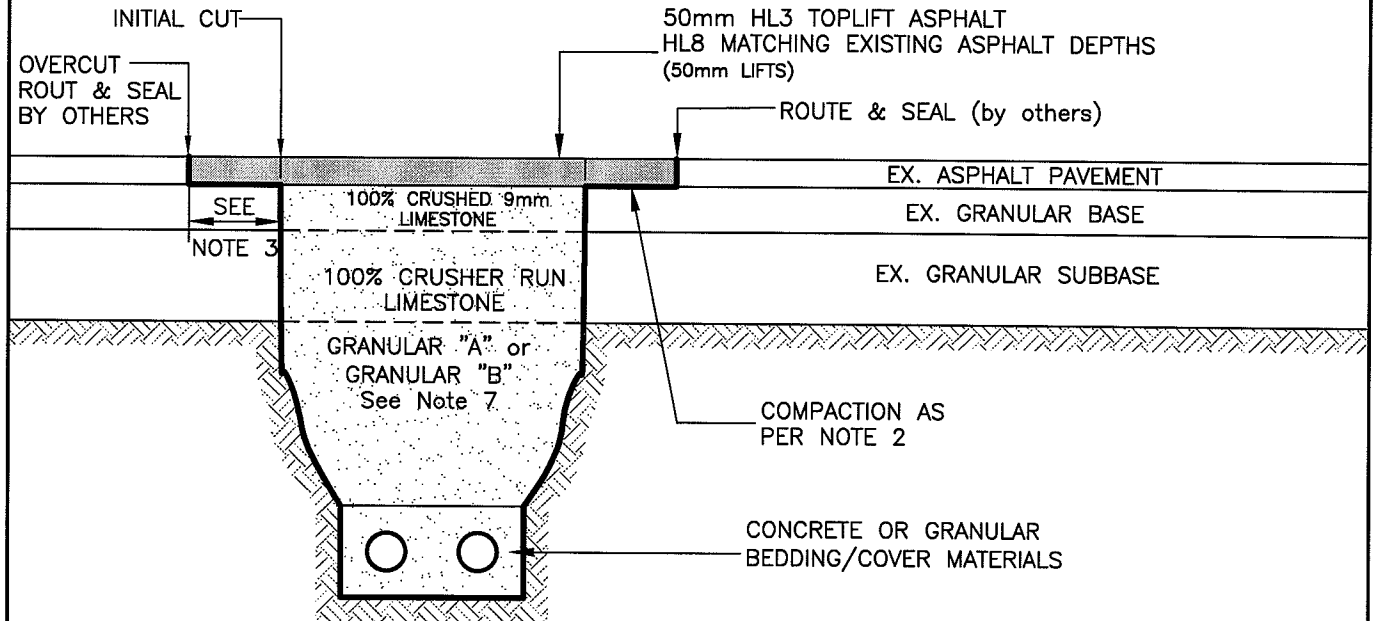

NOTES:

1. TACK COAT AND SEAL ALL VERTICAL ASPHALT SURFACES
2. COMPACT ALL GRANULAR MATERIAL TO AT LEAST 100% OF ITS STANDARD PROCTOR DENSITY.
3. MINIMUM STEP JOINT WIDTH FROM UNDISTURBED EDGE OF EXCAVATION
300mm FOR EXCAVATIONS LESS THAN 1.5m DEPTH
600mm FOR EXCAVATIONS GREATER THAN 1.5m DEPTH
4. OVERCUT AND PLACEMENT OF GRANULAR BASE/SUBBASE AND ASPHALT TO BE DONE AFTER PLACEMENT AND COMPACTION OF TRENCH BACKFILL.
5. ASPHALT OVERCUT AND RESTORATION TO BE COMPLETED BETWEEN APRIL 1 AND OCTOBER 31.
6. THIS DRAWING TO BE READ IN CONJUNCTION WITH CITY OF BURLINGTON AND OPSD STANDARD DRAWINGS AND SPECIFICATIONS
7. UNSHRINKABLE FILL SHALL BE USED WHERE DIRECTED BY THE CITY INSPECTOR.

APPROVED

DIRECTOR OF ENGINEERING

DATE: Feb. 6/02

CITY OF BURLINGTON
ENGINEERING DEPARTMENT

FLEXIBLE PAVEMENT
EXCAVATION REINSTATEMENT

METRIC

SCALE: N.T.S.

DWG. NO.

S-114A