


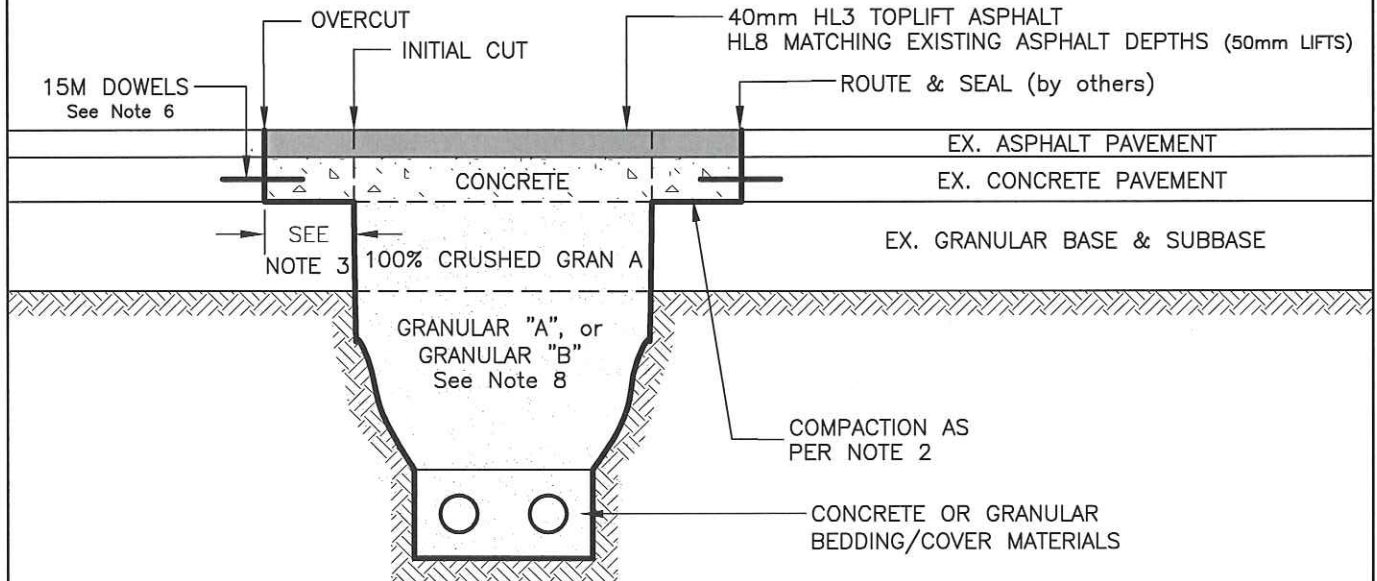

NOTES:

1. TACK COAT ALL VERTICAL ASPHALT SURFACES
2. COMPACT ALL GRANULAR MATERIAL TO AT LEAST 100% OF ITS STANDARD PROCTOR DENSITY.
3. MINIMUM STEP JOINT WIDTH FROM UNDISTURBED EDGE OF EXCAVATION
300mm FOR EXCAVATIONS LESS THAN 1.5m DEPTH
600mm FOR EXCAVATIONS GREATER THAN 1.5m DEPTH
4. OVERCUT AND PLACEMENT OF CONCRETE AND ASPHALT TO BE DONE AFTER PLACEMENT AND COMPACTION OF TRENCH BACKFILL.
5. ASPHALT OVERCUT AND RESTORATION TO BE COMPLETED BETWEEN APRIL 1 AND OCTOBER 31.
6. 15M DOWELS, 450mm LONG EPOXY COATED@300mm C/C EMBEDDED 225mm IN EXISTING CONCRETE AND SET WITH EPOXY GROUT.
7. THIS DRAWING TO BE READ IN CONJUNCTION WITH CITY OF BURLINGTON AND OPSD STANDARD DRAWINGS AND SPECIFICATIONS
8. UNSHRINKABLE FILL SHALL BE USED WHERE DIRECTED BY THE CITY INSPECTOR.
9. CONCRETE AS PER C-2 (ITEM 11-CONCRETE) CITY OF BURLINGTON AMENDMENTS TO OPSS

APPROVED

DIRECTOR OF ENGINEERING

DATE: JUNE 5/12.

CITY OF BURLINGTON
ENGINEERING DEPARTMENTCOMPOSITE OR EXPOSED PAVEMENT
EXCAVATION REINSTATEMENT

METRIC

SCALE: N.T.S.

DWG. NO.
S-115A