



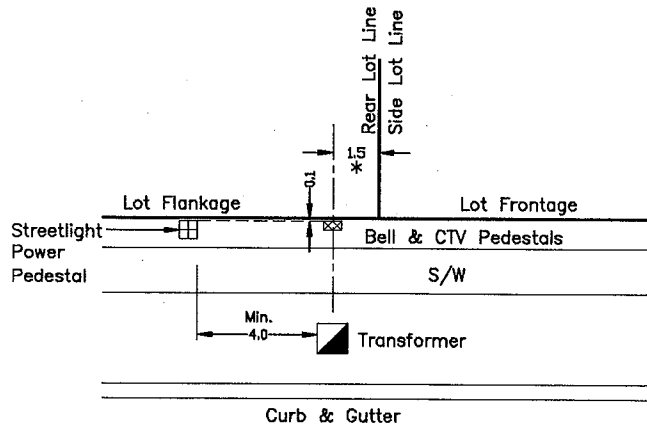


A – Preferred Locations Corner Lot Flankage

* Dimension is 0.0m if lot line is rear of both abutting lots.

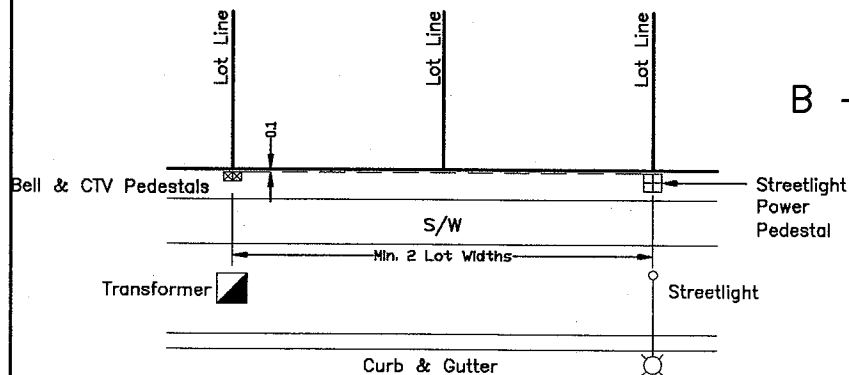

B – 1st Alternative Locations Cluster @ Transformer

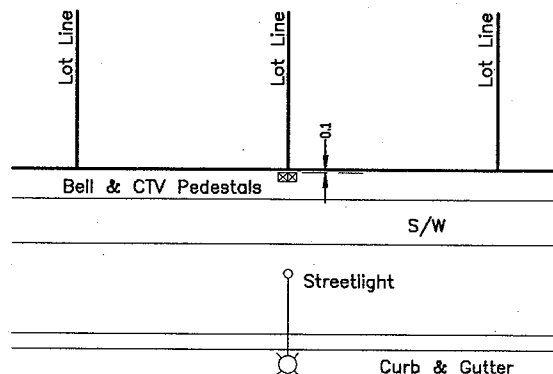

C – 2nd Alternative Locations Cluster @ Streetlight

NOTES

1. Bell, Cablenet and City streetlight power pedestals to be 0.1m from streetline.
2. Bell and Cablenet pedestals to be located side to side parallel to roadway.
3. Pedestals to be located in clusters with above ground services.
4. Number of Bell and Cablenet pedestals to be minimized, generally at 60m to 80m intervals.
5. Maximum of 2 aboveground utility installations per lot frontage..
6. Above ground utilities to be minimum 1m from driveways.
7. Oversize pedestals (OPI, transformers etc.) to be located on lot flankage or open space blocks.
8. New site plan installations – Locate aboveground pedestals in front of the new development.
9. No aboveground plant to be installed within 4.0m of the door side of the transformer. (Door side is such that a worker opening the door faces oncoming traffic.)

Original Signed By

T. Eide

DIRECTOR OF ENGINEERING

DATE:

Feb. 17/99

CITY OF BURLINGTON
ENGINEERING DEPARTMENT

UTILITY PEDESTAL LOCATIONS

METRIC
SCALE: N.T.S.

DWG. NO.
S-117