
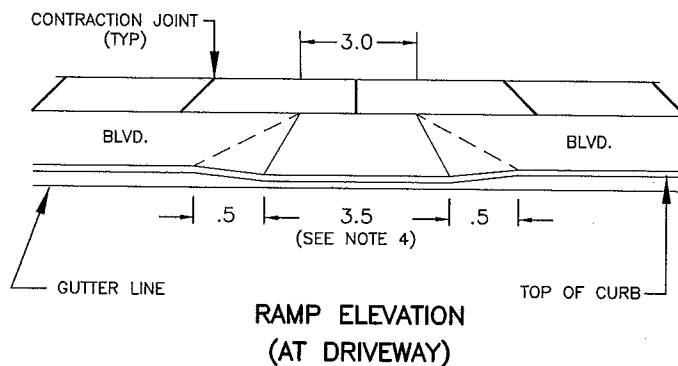
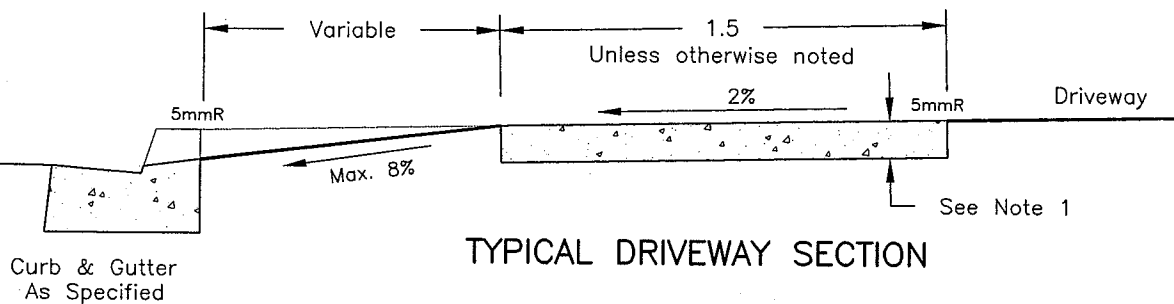
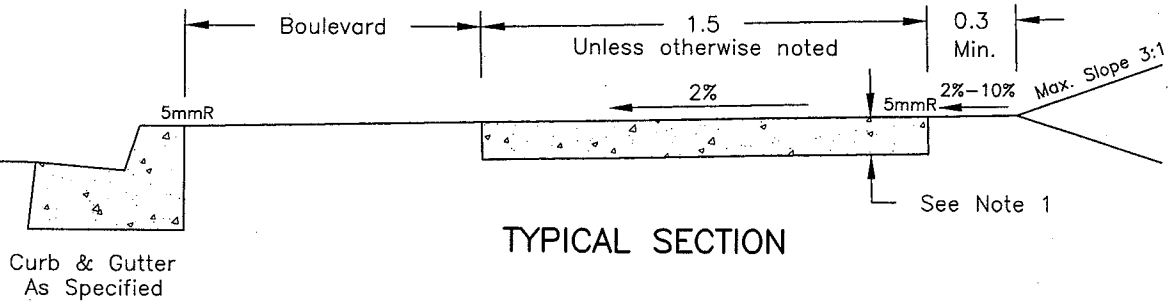


NOTES:

- 1) SIDEWALK THICKNESS - 125mm
RESIDENTIAL DRIVEWAYS and PEDESTRIAN RAMPS - 150mm
COMMERCIAL AND INDUSTRIAL DRIVEWAYS - 200mm
- 2) EXPANSION JOINTS TO BE 30.0m c/c MAX.
- 3) CONTRACTION JOINTS TO BE 2.5m c/c MAX.
- 4) SINGLE DRIVEWAY - 3.0m MIN. WIDTH FLARING TO 3.5
DOUBLE DRIVEWAY - 5.5m MIN. WIDTH FLARING TO 6.0m
- 5) ALL JOINTS TO BE PERPENDICULAR TO THE LINE OF THE SIDEWALK
- 6) FOR SIDEWALK RAMP DETAIL REFER TO DRAWING S-123



DIMENSIONS IN m EXCEPT AS NOTED

APPROVED

J. Eide
DIRECTOR OF ENGINEERING

DATE:

Oct. 13/04

CITY OF BURLINGTON
ENGINEERING DEPARTMENT

SIDEWALK WITH BOULEVARD

METRIC
SCALE: N.T.S.

DWG. NO.

S-121