



Concrete Properties: Concrete as per C-2(item 11-concrete)
City of Burlington Amendments to OPSS
Six(6) Cable entry openings - PVC seals for max 101.6mm I.D. duct
Reinforcing Steel as per manufacturers recommendation
Four(4) - 12.7mm N.C. plastic threaded inserts in lid as shown

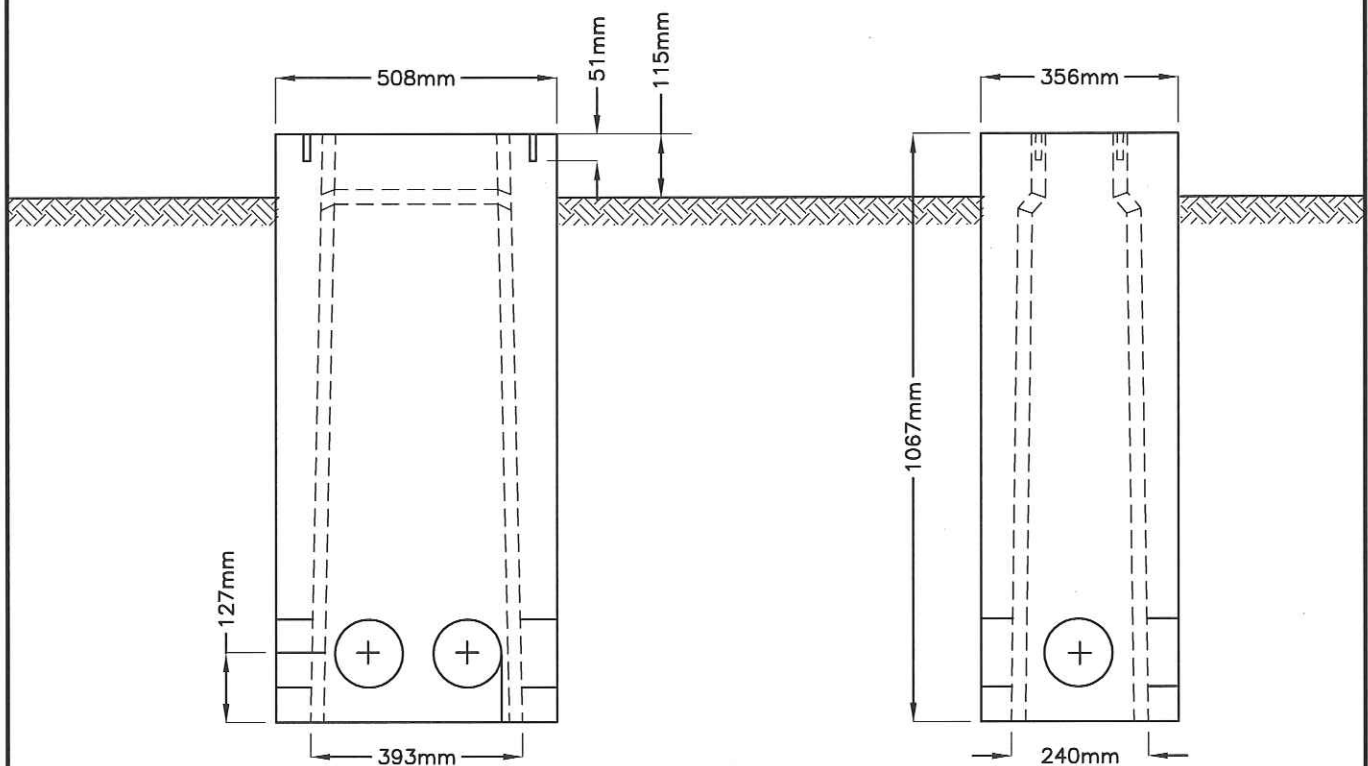

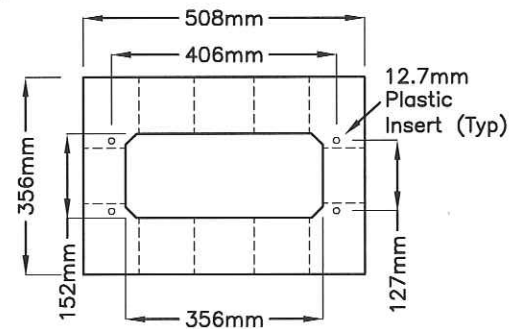

DIRECTOR OF ENGINEERING

DATE: JUNE 5/12

POWER PEDESTAL
BASE (CONCRETE)

DWG. NO.

S-156A