



DATE: JUNE/98

NEW

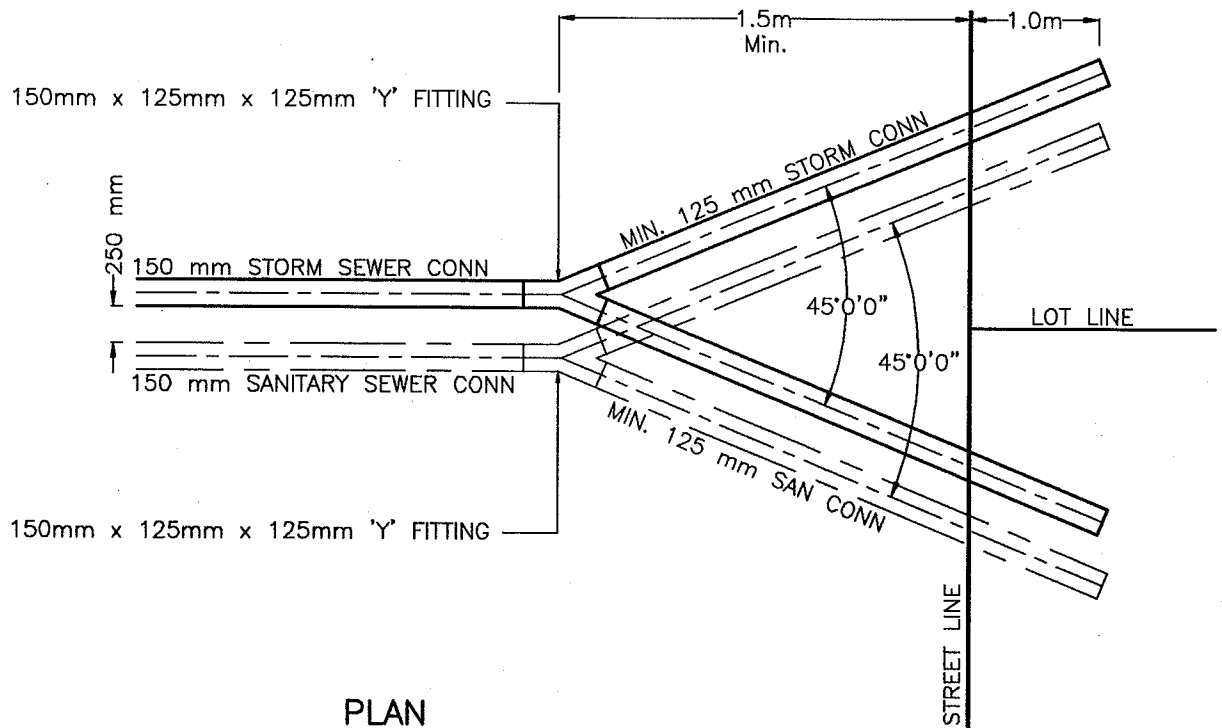

PLAN

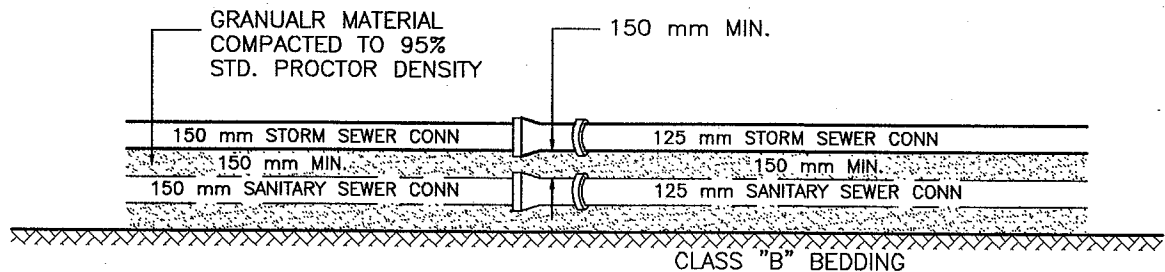

PROFILE

NOTES:

1. MINIMUM TRENCH WIDTH TO BE 900 mm.
2. CLASS "B" BEDDING TO BE USED TO SPRING LINE OF UPPER PIPE COMPACTED TO 95% STD. PROCTOR DENSITY
3. THE SANITARY CONNECTION SHALL ALWAYS BE BELOW THE STORM CONNECTION.
4. THE SANITARY CONNECTION SHALL ALWAYS BE ON THE RIGHT WHEN FACING THE HOUSE.
5. SEE STANDARD DRAWINGS S-183 AND S-185A FOR OTHER DETAILS.
6. STORM LATERAL TO BE WHITE.

APPROVED

J. Eidenbaum
DIRECTOR OF ENGINEERING

DATE:

Feb. 17/99

CITY OF BURLINGTON
ENGINEERING DEPARTMENT

ALTERNATE
STORM & SANITARY SEWERS
RESIDENTIAL CONNECTIONS

METRIC

SCALE: N.T.S.

DWG. NO.

S-185B