
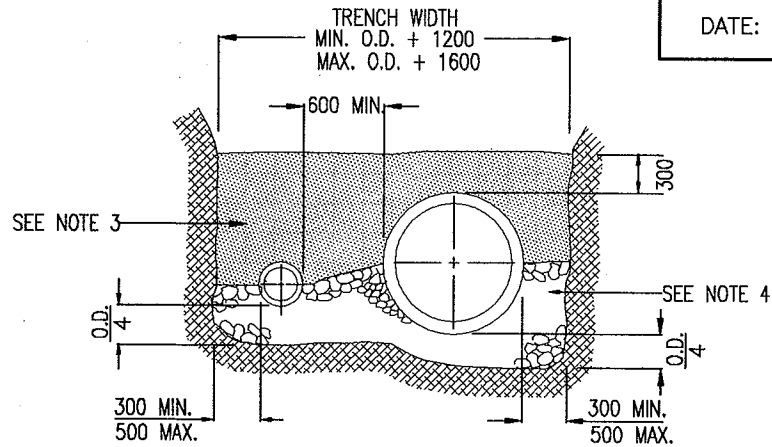


DETAIL A

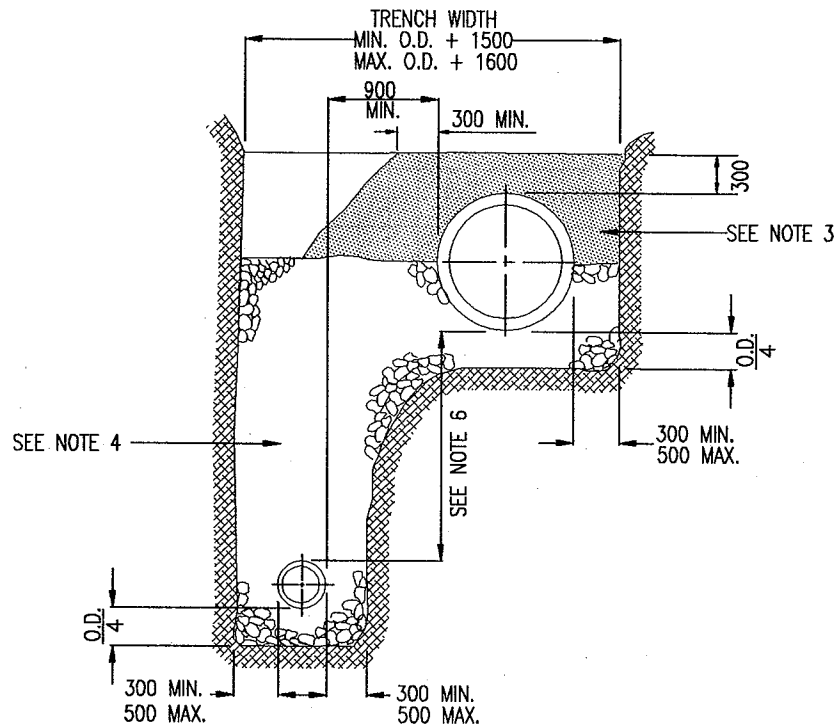

DETAIL B

NOTE:

- 1) O.D. NOT TO INCLUDE BELL
- 2) TRENCH WIDTH AS SHOWN SHALL BE MAINTAINED TO THE LEVEL OF THE TOP OF PIPE
- 3) GRANULAR MATERIAL COMPACTED TO 95% STD. PROCTOR DENSITY. STONE SIZE WITHIN 300mm OF PIPE SURFACE SHALL NOT EXCEED 25mm
- 4) M.T.O. GRANULAR 'A' COMPACTED TO 95% STD. PROCTOR DENSITY
- 5) GRANULAR BACKFILL MATERIAL COMPACTED TO 95% STD. PROCTOR DENSITY TO BE USED IN ALL TRENCHES UNDER ROADWAYS, CURBS AND EXISTING OR PLANNED DRIVEWAYS.
- 6) VERTICAL SEPARATION SHALL NOT EXCEED 2.5m

DIMENSIONS IN mm EXCEPT AS NOTED

APPROVED

T. Eickmeier
DIRECTOR OF ENGINEERING

DATE:

Feb. 17/99

CITY OF BURLINGTON
ENGINEERING DEPARTMENT

**COMMON TRENCH FOR
STORM & WASTEWATER MAIN**

METRIC

SCALE: N.T.S.

DWG. NO.

S-186