


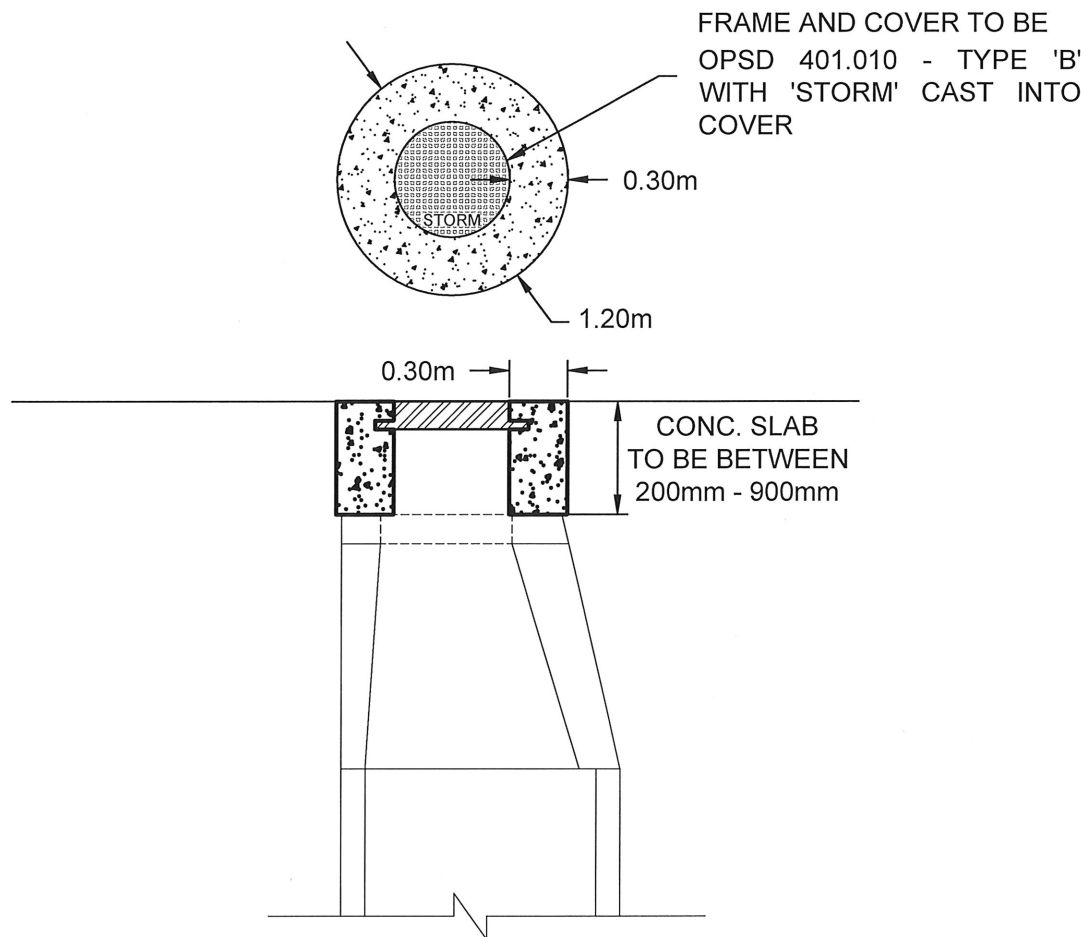

1. CONCRETE SHALL BE 30MPA HIGH EARLY STRENGTH (20MPA AT 24HRS). MIX DESIGN SHALL BE IN ACCORDANCE WITH COB STANDARD SPECIFICATIONS.
2. CONCRETE SHALL BE CURED WITH WHITE PIGMENTED CURING COMPOUND MEETING REQUIREMENTS OF OPSS 1315 AND APPLIED AT A RATE OF 0.2l/m²
4. STEPS ARE TO BE INSTALLED AS REQUIRED AS PER COB STANDARD SPECIFICATIONS.
5. TRAFFIC CONTROL SHALL BE IN PLACE AND CONFORM TO MTO BOOK 7 AND TO CONTRACT CONDITIONS.
6. IF THE DISTANCE FROM THE TOP OF PRECAST STRUCTURE TO THE TOP OF PAVEMENT IS LESS THAN 200mm THE CITY SHALL BE NOTIFIED PRIOR TO FORMING.
4. IF THE DISTANCE FROM THE TOP OF PRECAST STRUCTURE TO THE TOP OF PAVEMENT IS GREATER THAN 900mm THE CITY SHALL BE NOTIFIED PRIOR TO FORMING.

APPROVED

MANAGER OF DESIGN AND CONSTRUCTION

DATE:

MAR 3/20

CITY OF BURLINGTON
CAPITAL WORKS DEPARTMENT

CORED MAINTENANCE
HOLE ADJUSTMENT

METRIC
SCALE: N.T.S.

DWG. NO.
S-130