




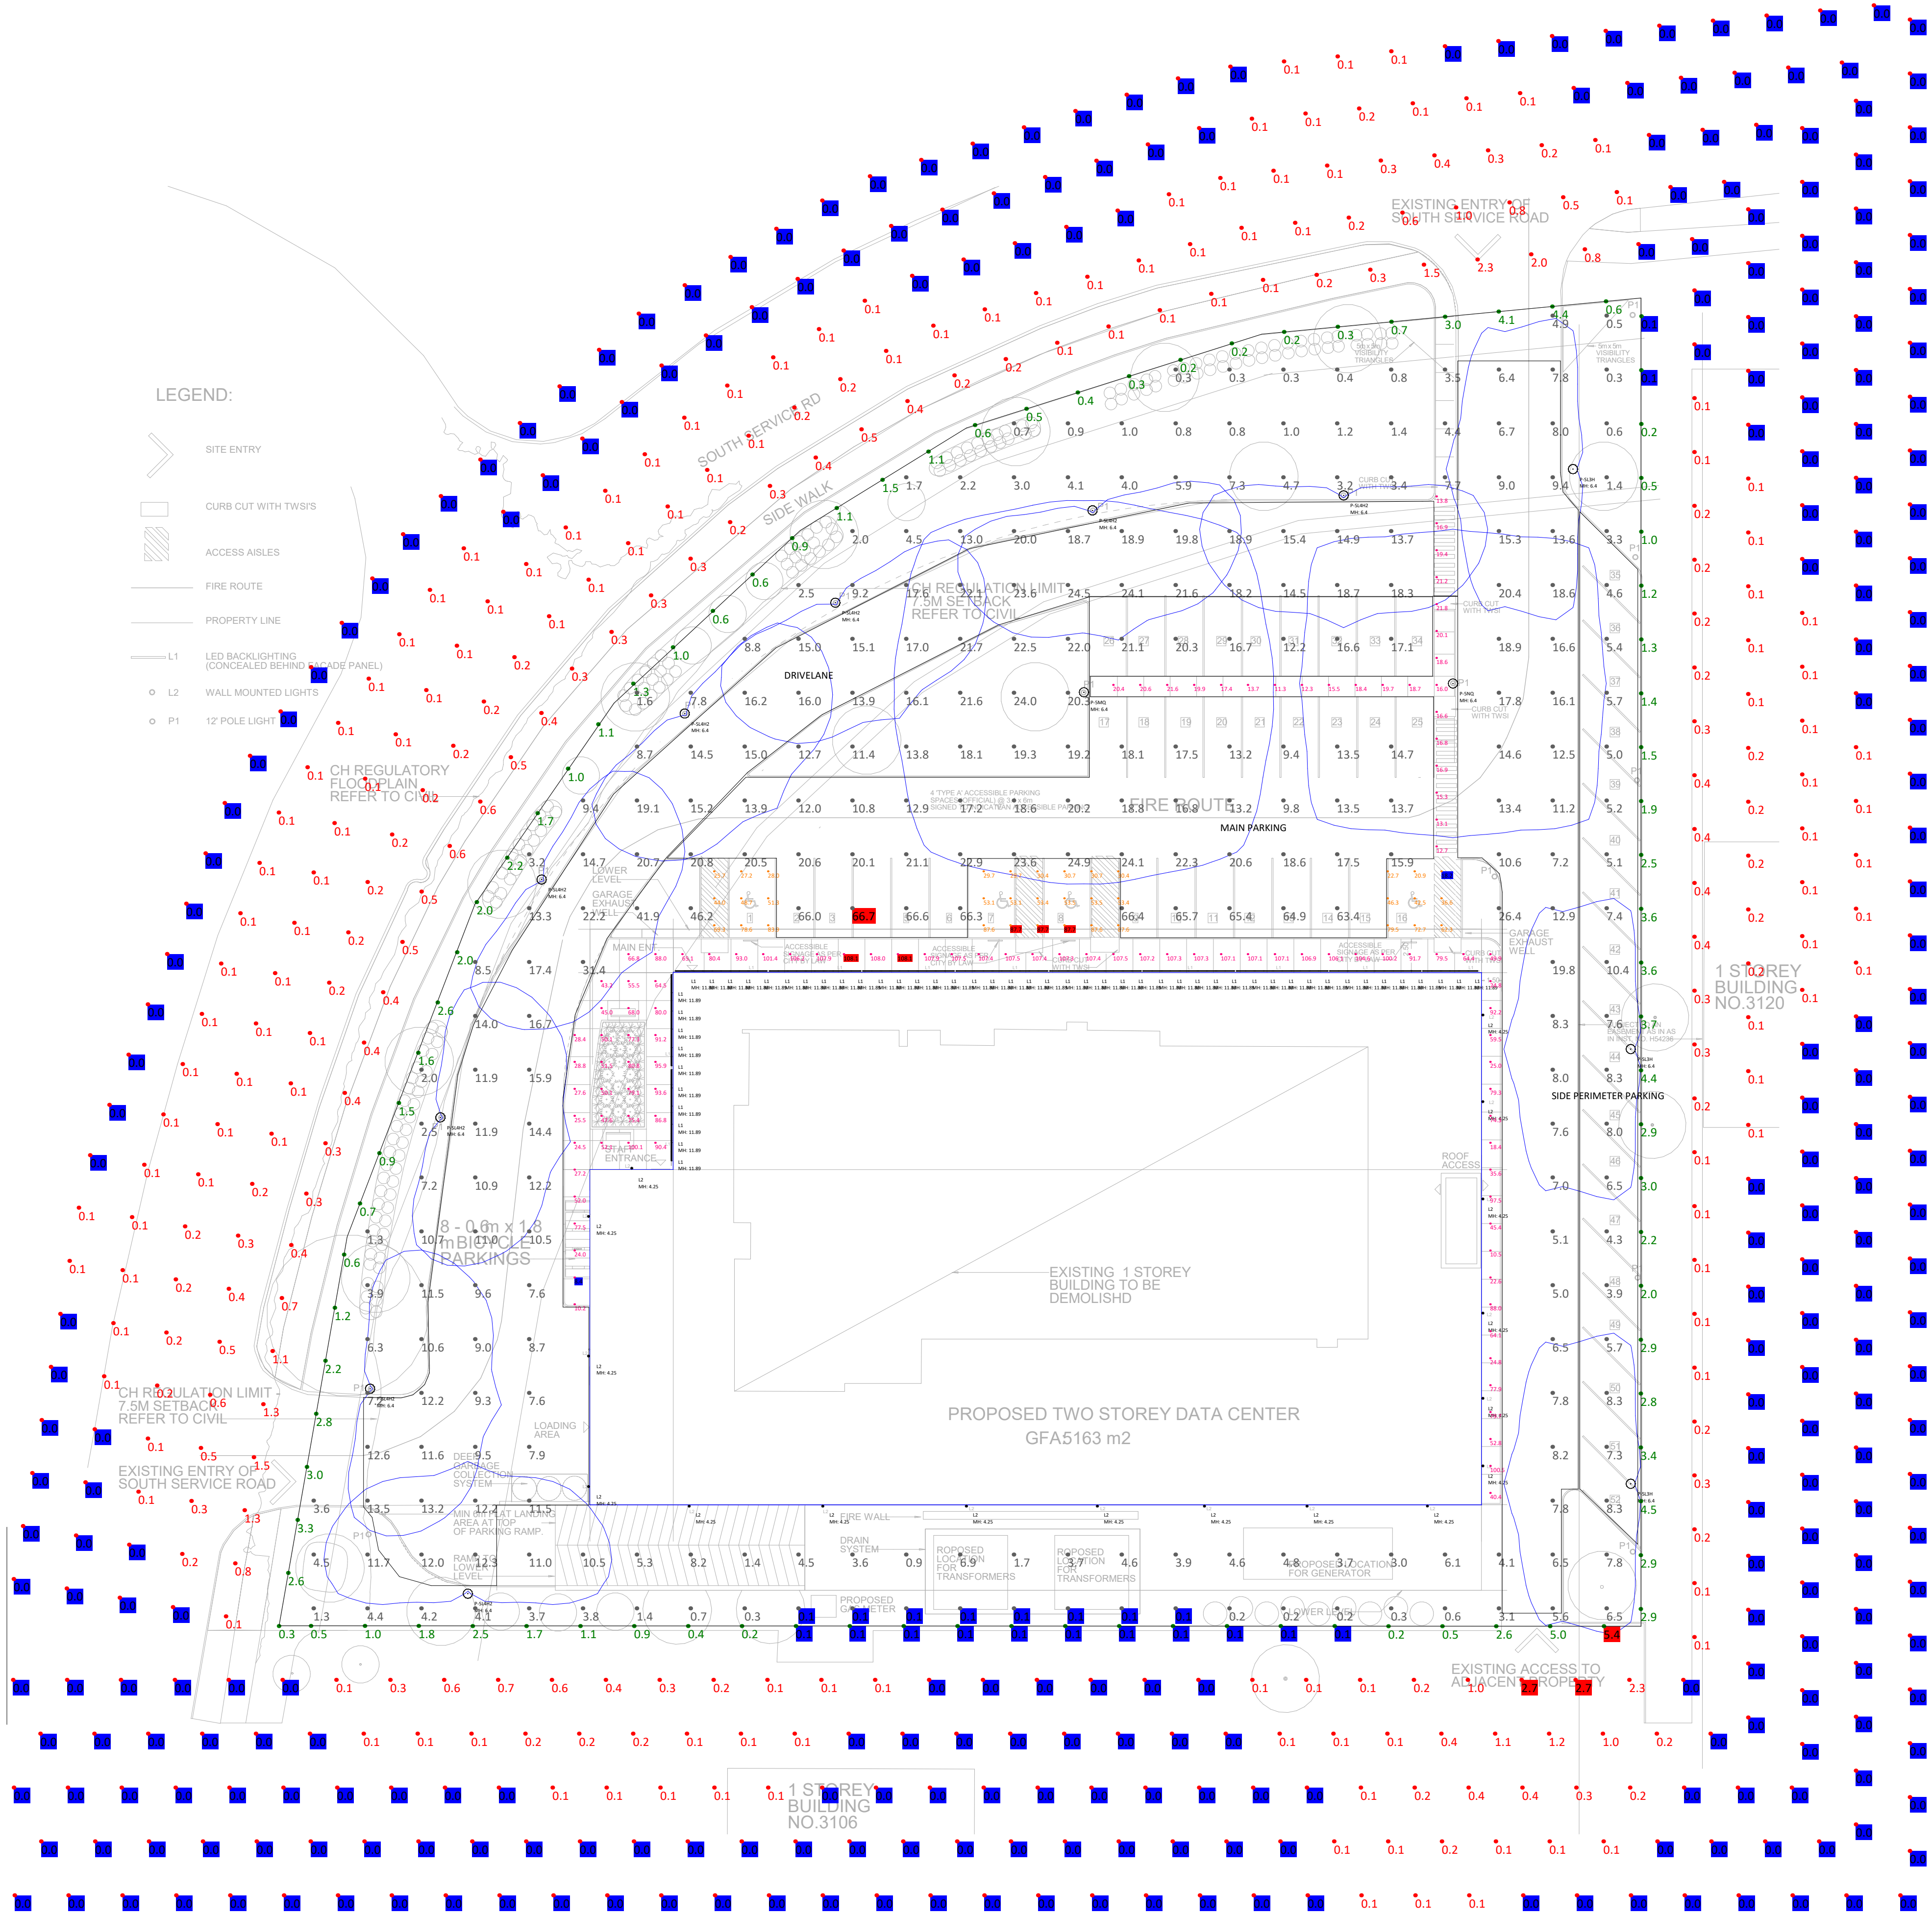



Luminaire Schedule					LLF	Luminaire Lumens	Luminaire Watts	Total Watts	BUG Rating
Symbol	Qty	Label	Arrangement	Description					
○	3	P-SL3H	Single	MSA-SA1A-830-U-SL3-HSS	0.900	2637	34	102	80-U0-G1
○	8	P-SL4H2	Single	MSA-SA1B-830-U-SL4-HSS	0.900	3328	44	352	80-U0-G1
○	1	P-SN-Q	Single	MSA-SA2A-830-U-SN-Q	0.900	6463	66	66	82-U0-G1
○	1	P-SM-Q	Single	MSA-SA2C-830-U-SM-Q	0.900	10558	113	113	83-U0-G2
○	17	L2	Single	CYL-20-30W-347V-PC_15W_Downlight_3000K	0.900	1682	15.7	266.9	82-U0-G0
○	53	L1	Single	GR2-05L-930-50x60-X-UNV-STD-4F	0.900	1920	19.3	1022.9	82-U0-G0


LPD Area Summary			
Label	Area	Total Watts	LPD
LPDArea_1	7950	1922.799	0.242
			Watts/Sq.m


Calculation Summary						
Label	CalcType	Units	Avg	Max	Min	Avg/Min
20M BEYOND PROPERTY LINE	Illuminance	Lux	0.13	2.7	0.0	N.A.
ACCESSIBLE PARKING	Illuminance	Lux	52.39	87.7	18.2	2.88
PROPERTY LINE	Illuminance	Lux	1.54	5.4	0.1	15.80
SITE @ GRADE	Illuminance	Lux	12.29	66.7	0.1	122.90
WALKWAY	Illuminance	Lux	59.58	108.1	8.4	7.09
DRIVELANE	Illuminance	Lux	13.70	31.4	5.0	2.74
MAIN PARKING	Illuminance	Lux	26.39	66.7	9.4	7.10
SIDE PERIMETER PARKING	Illuminance	Lux	6.50	10.4	3.9	1.67

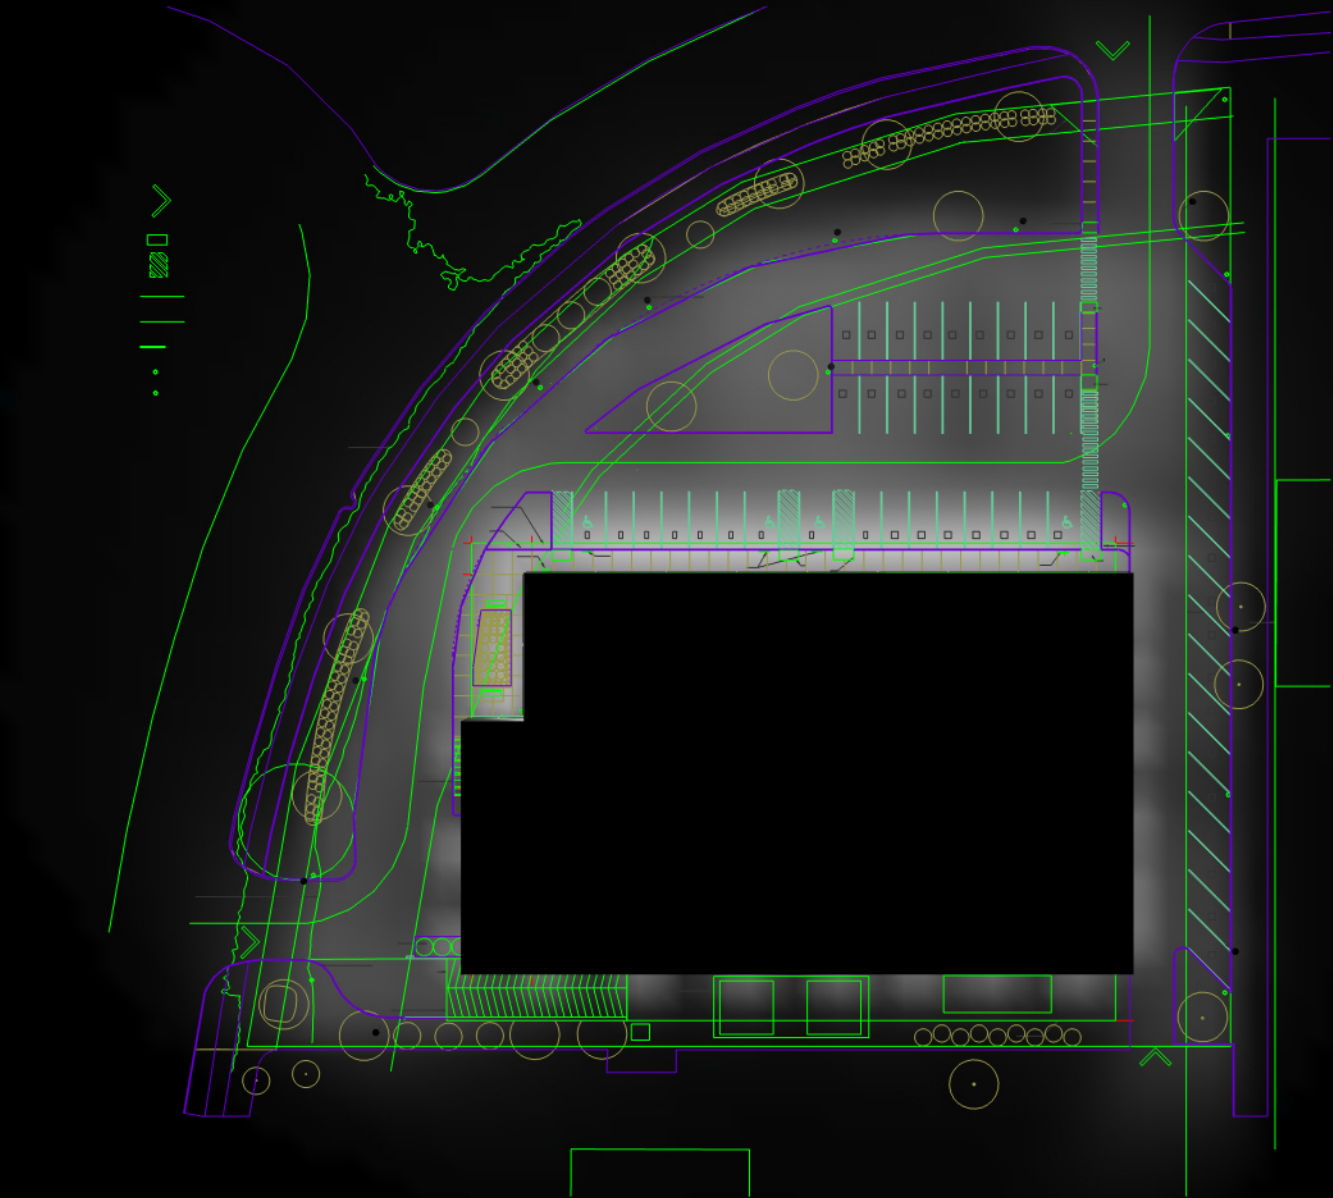


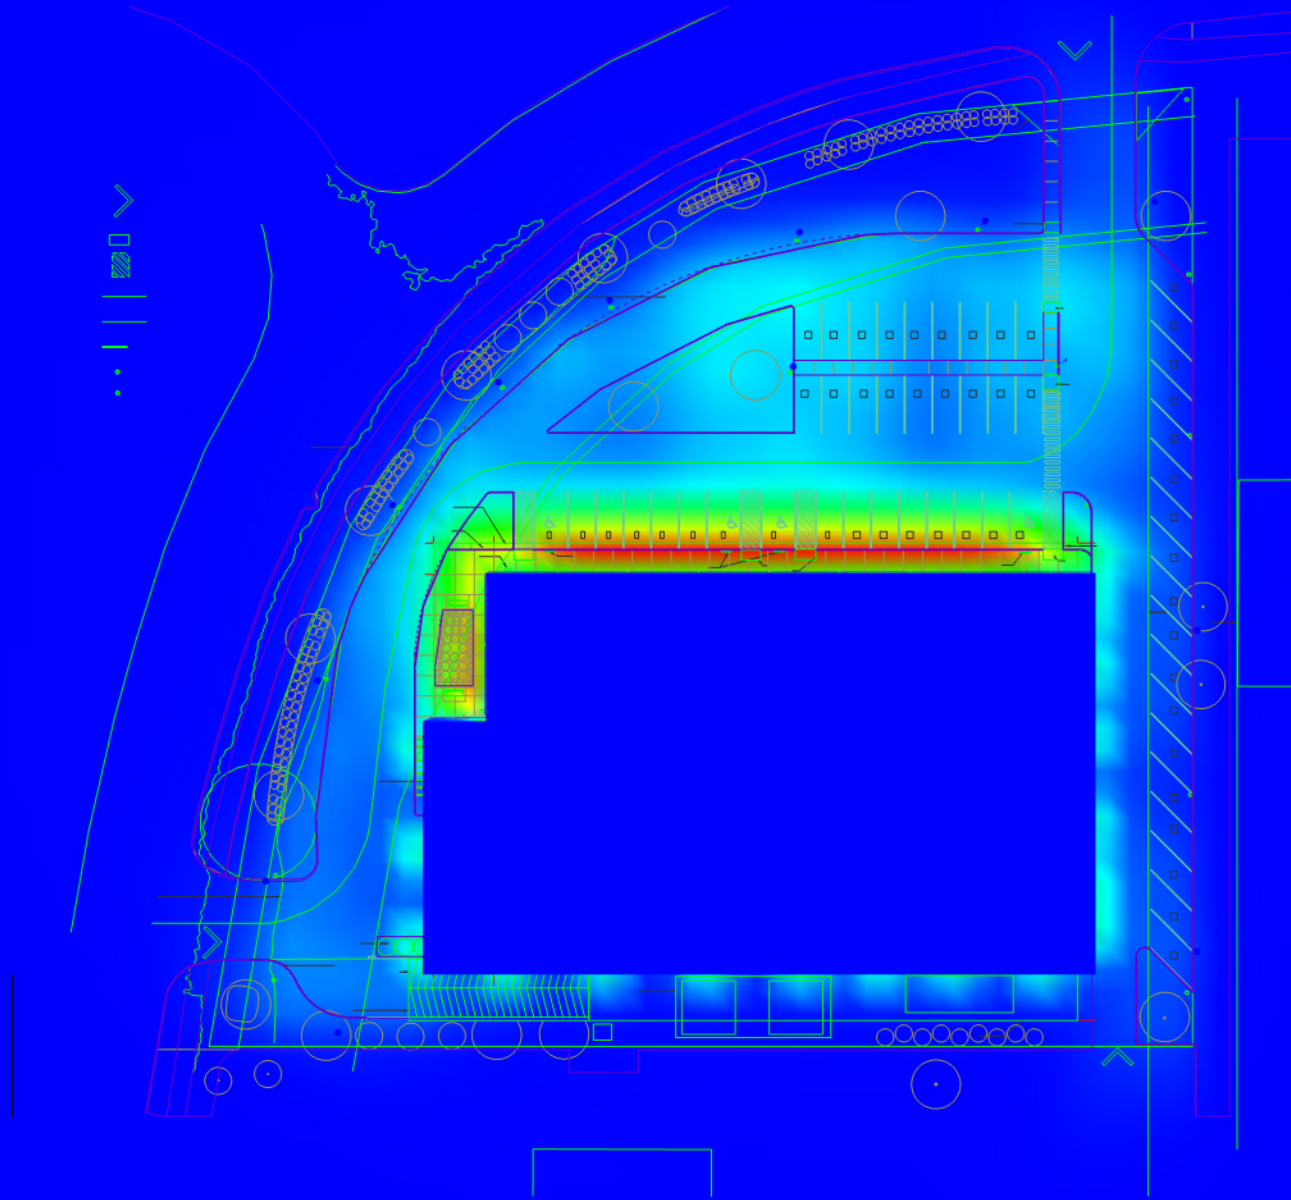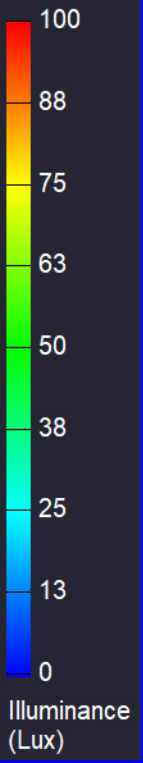


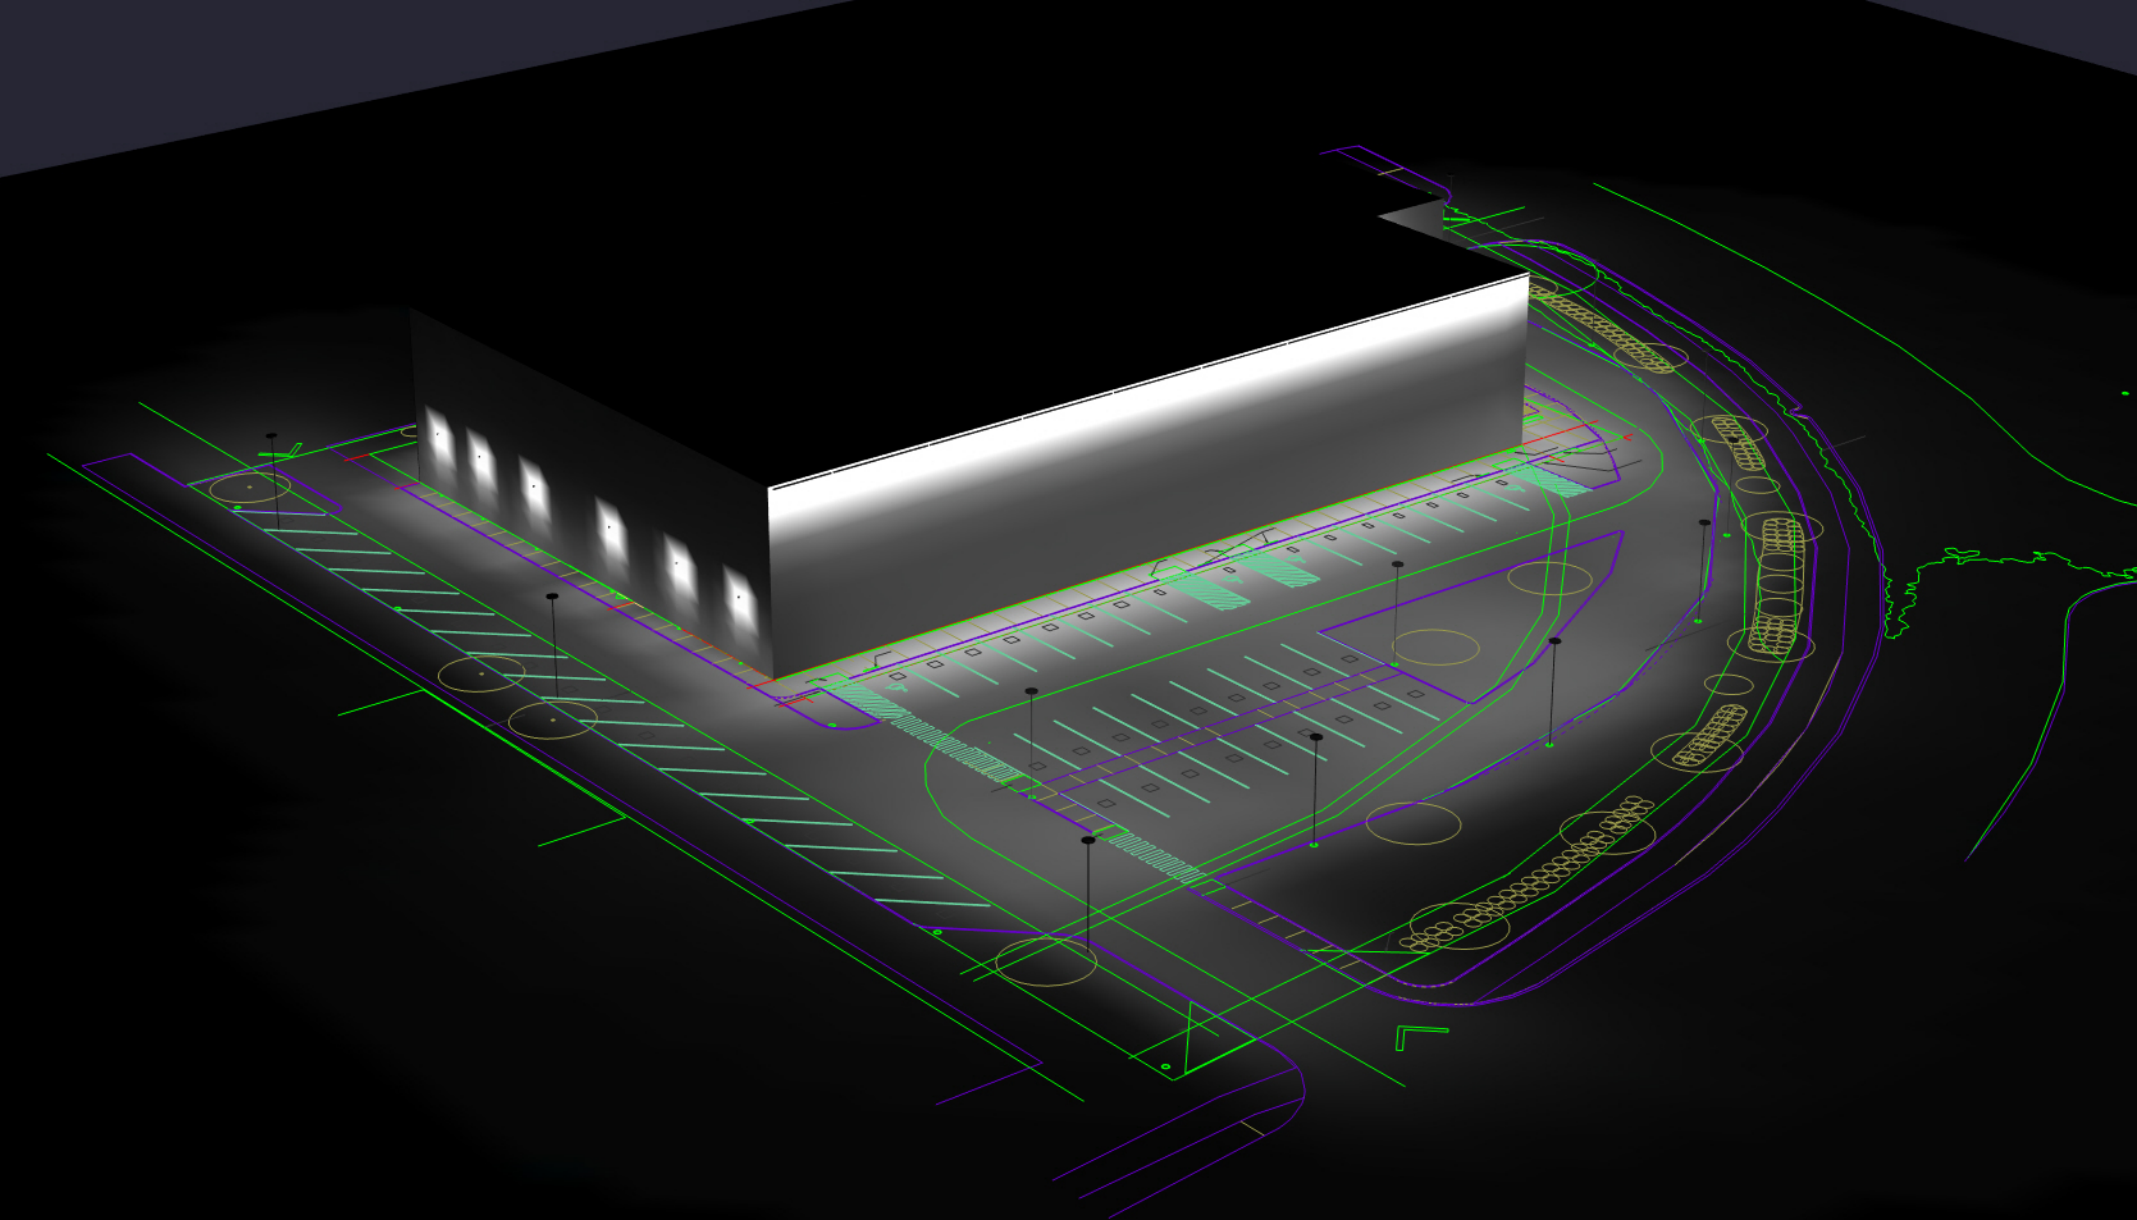


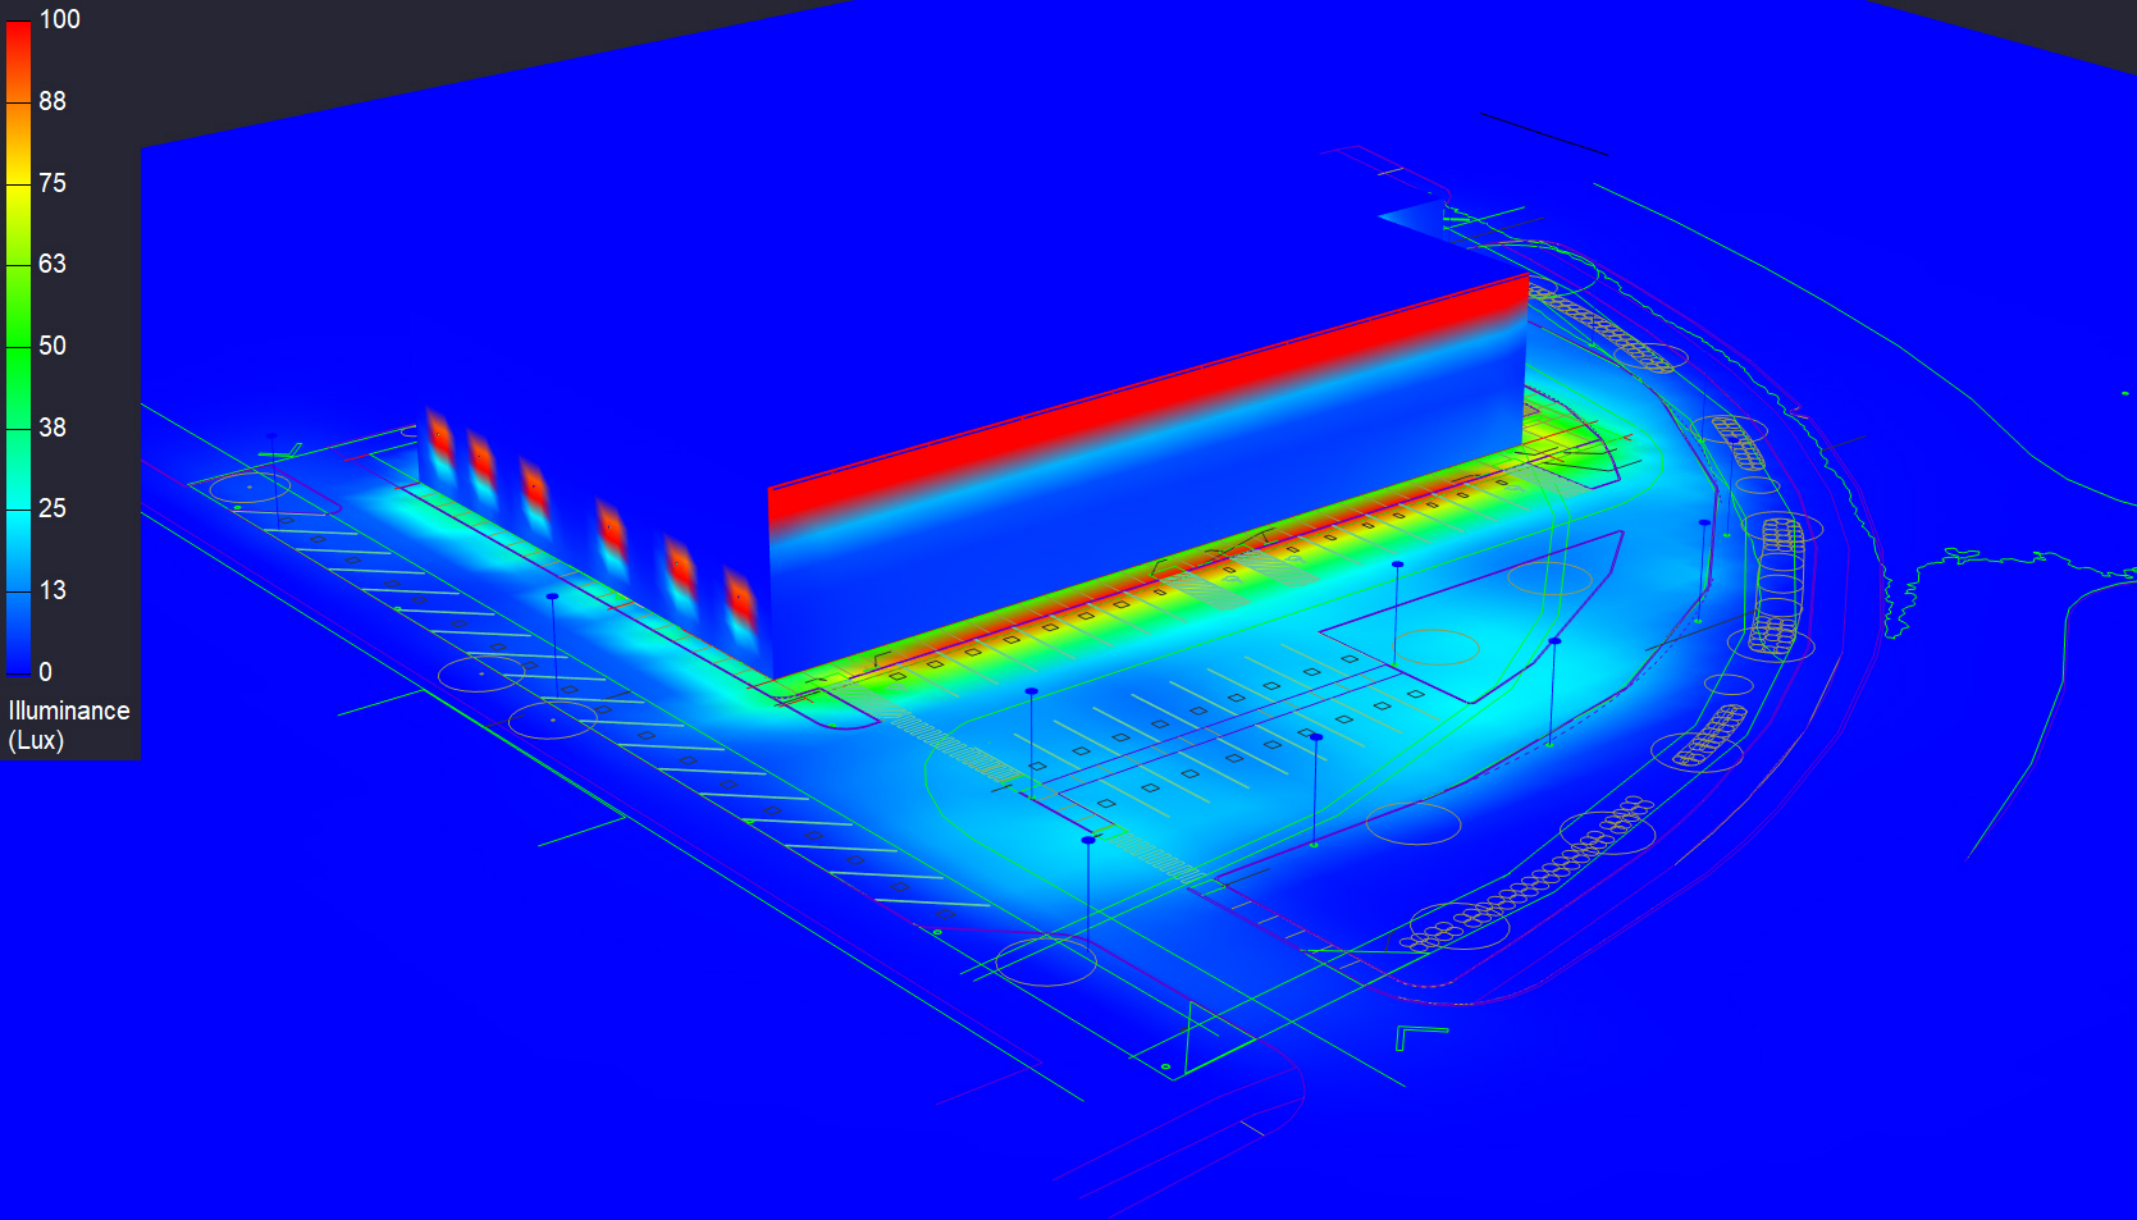

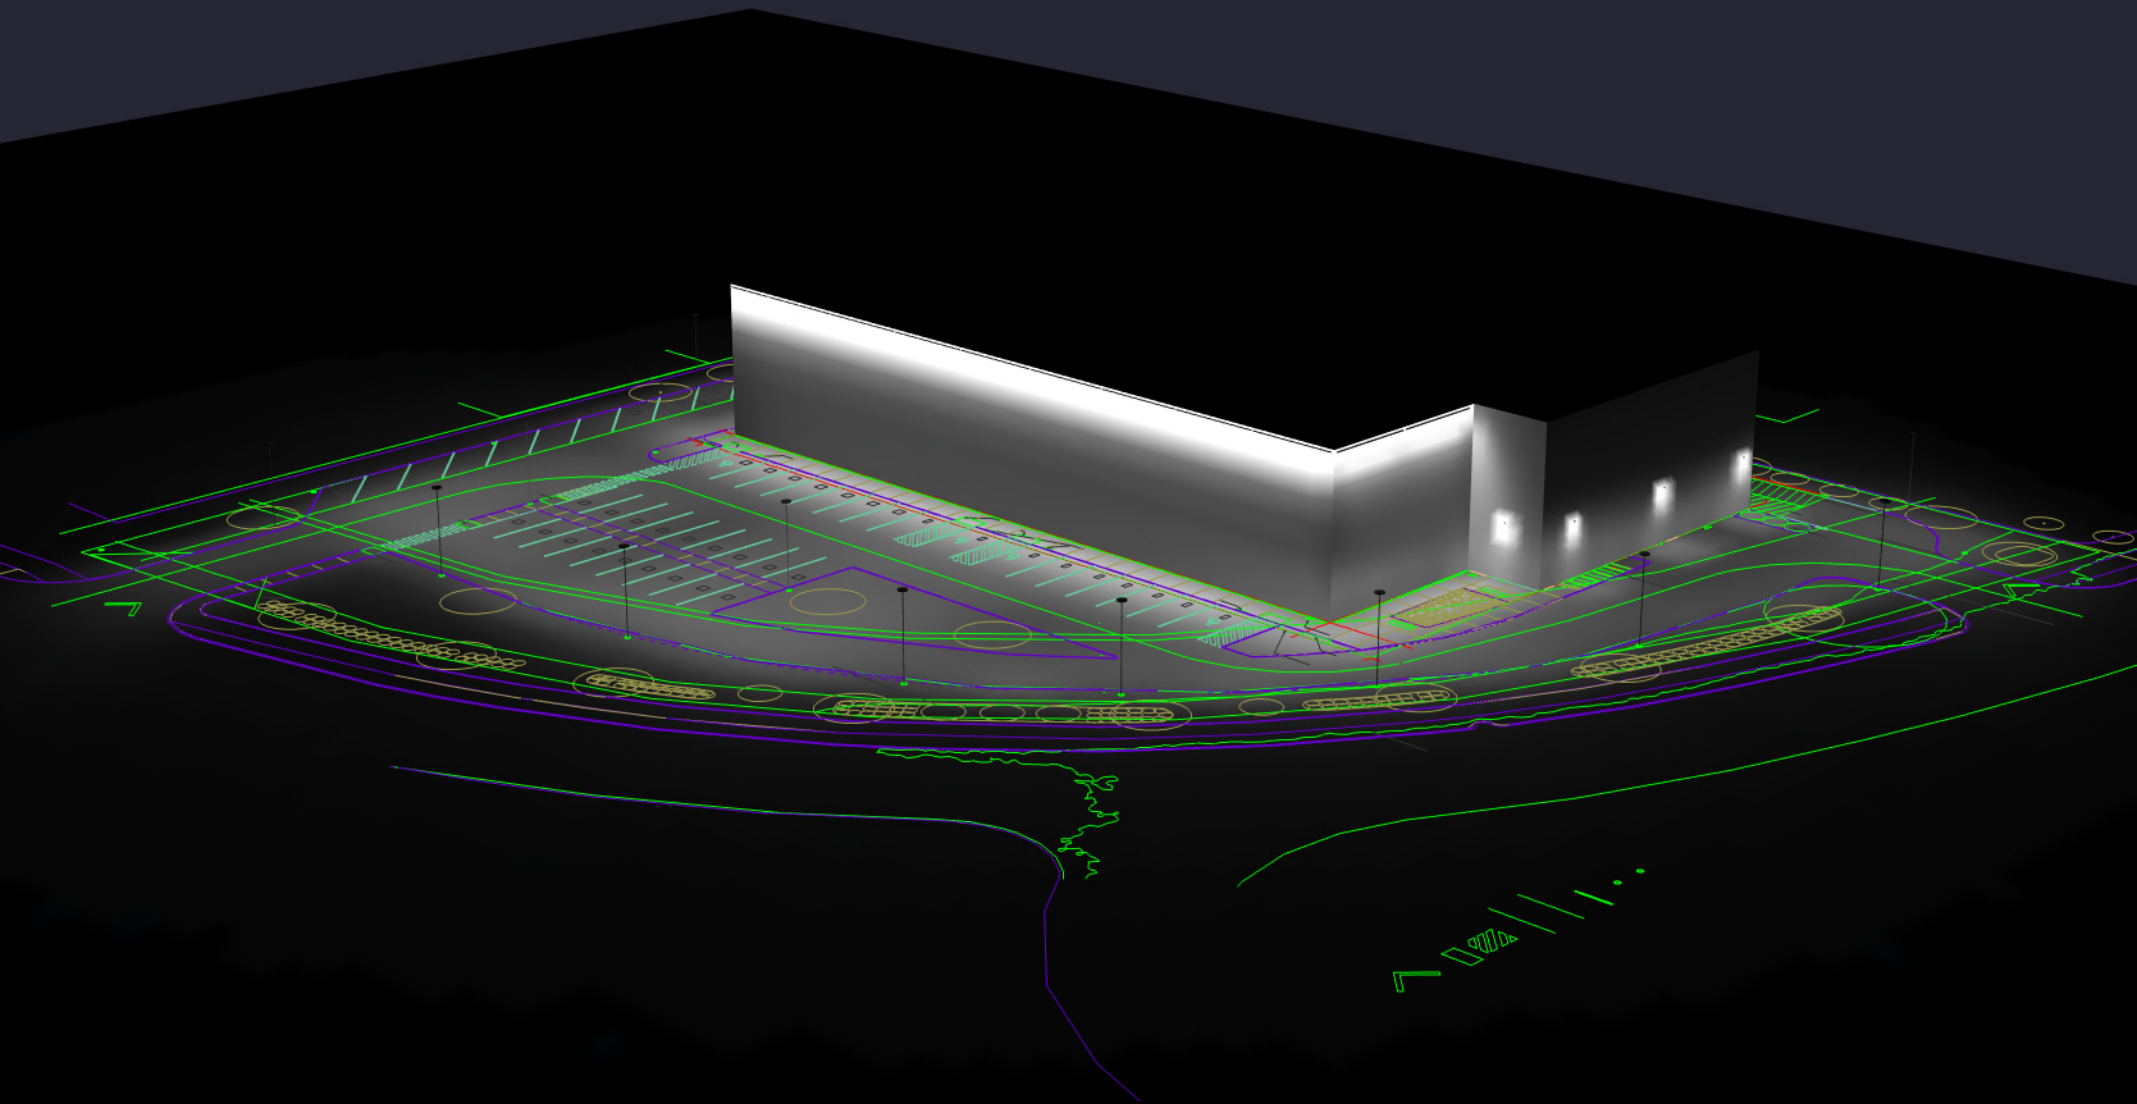

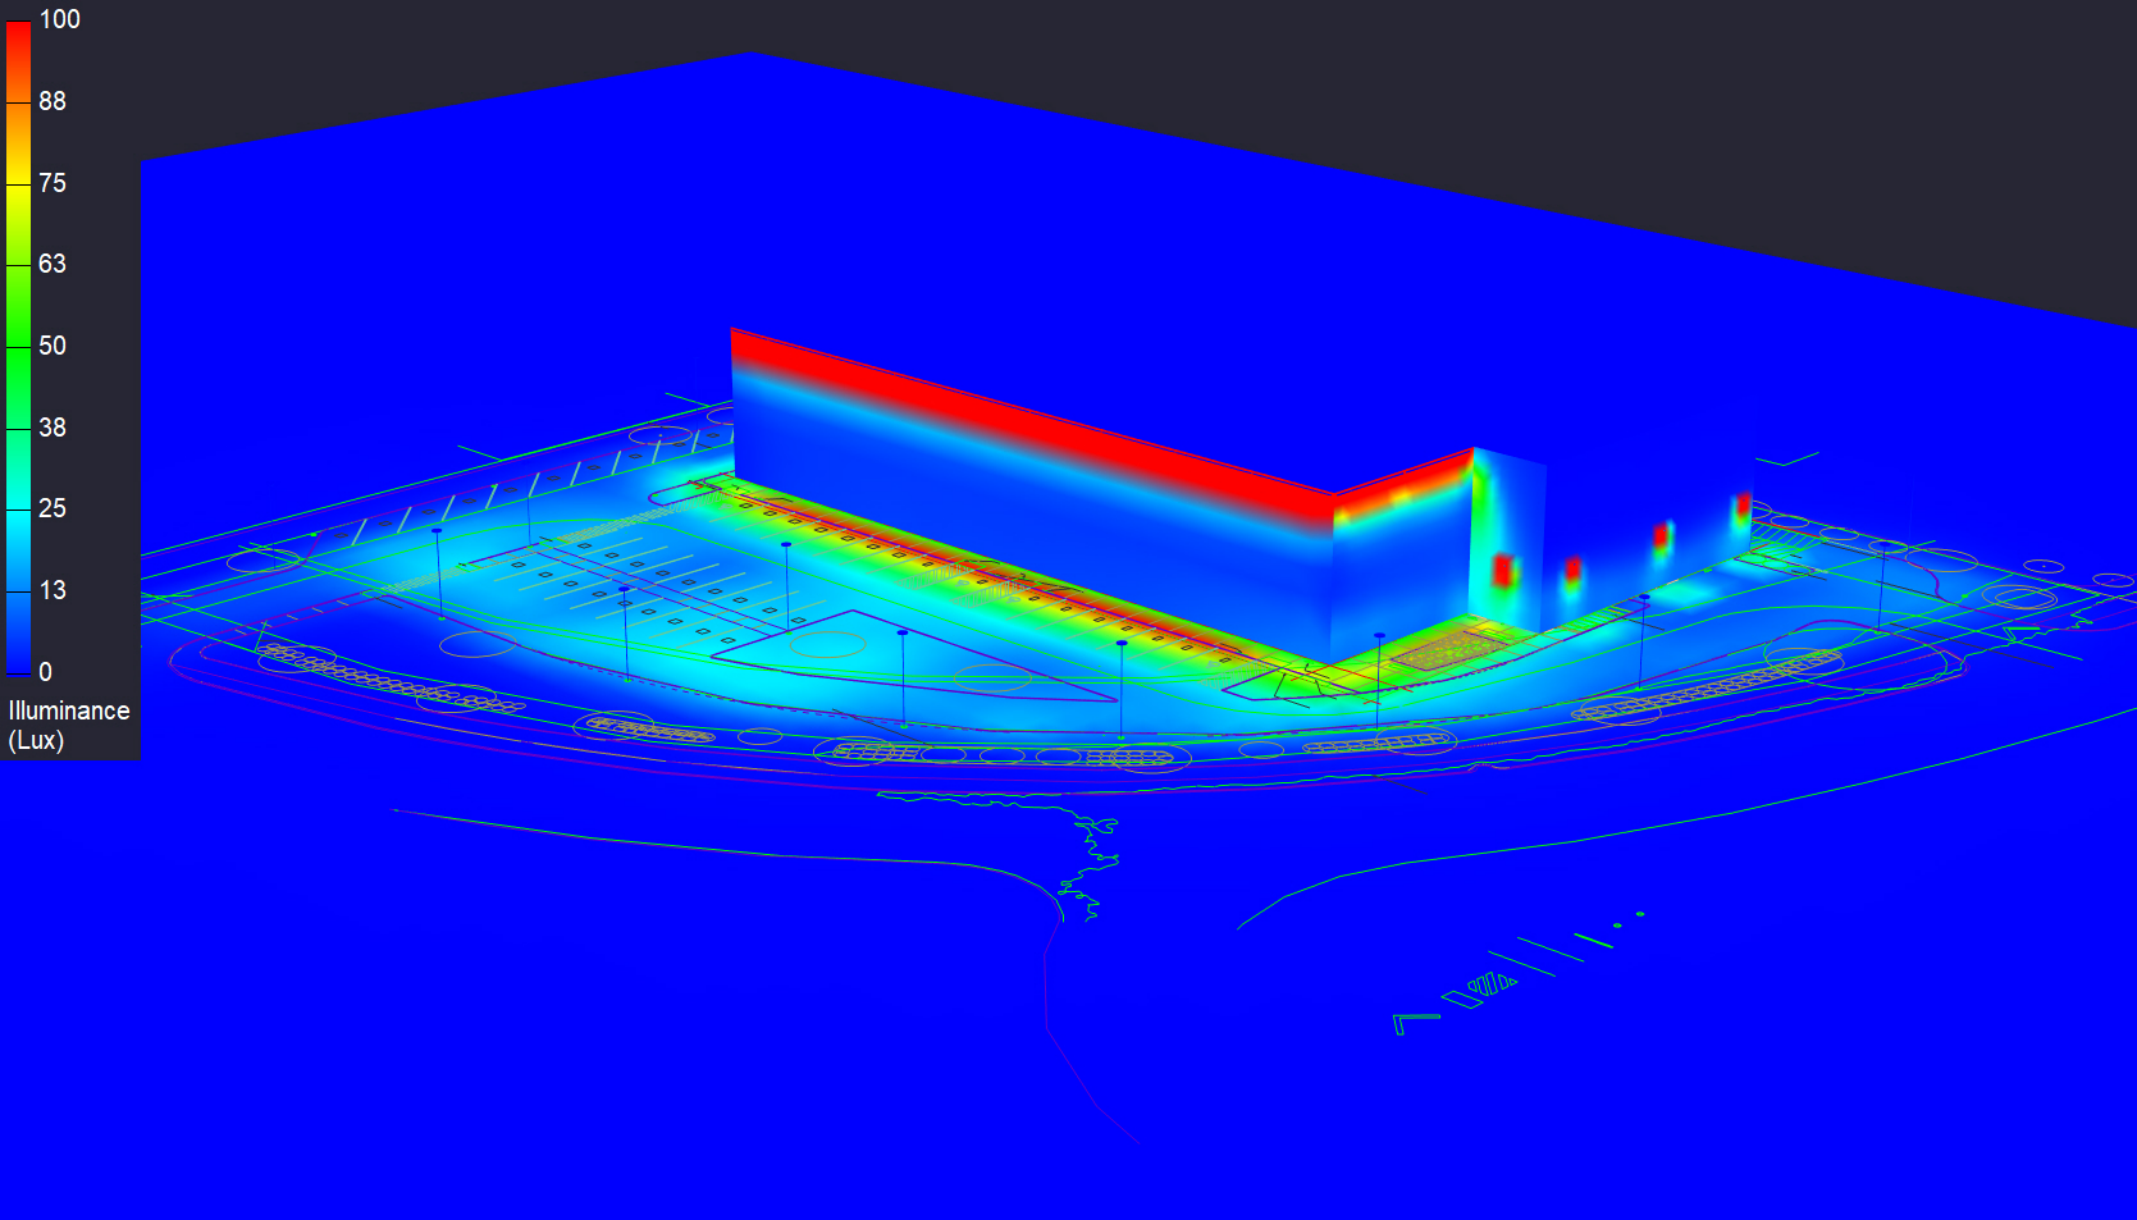

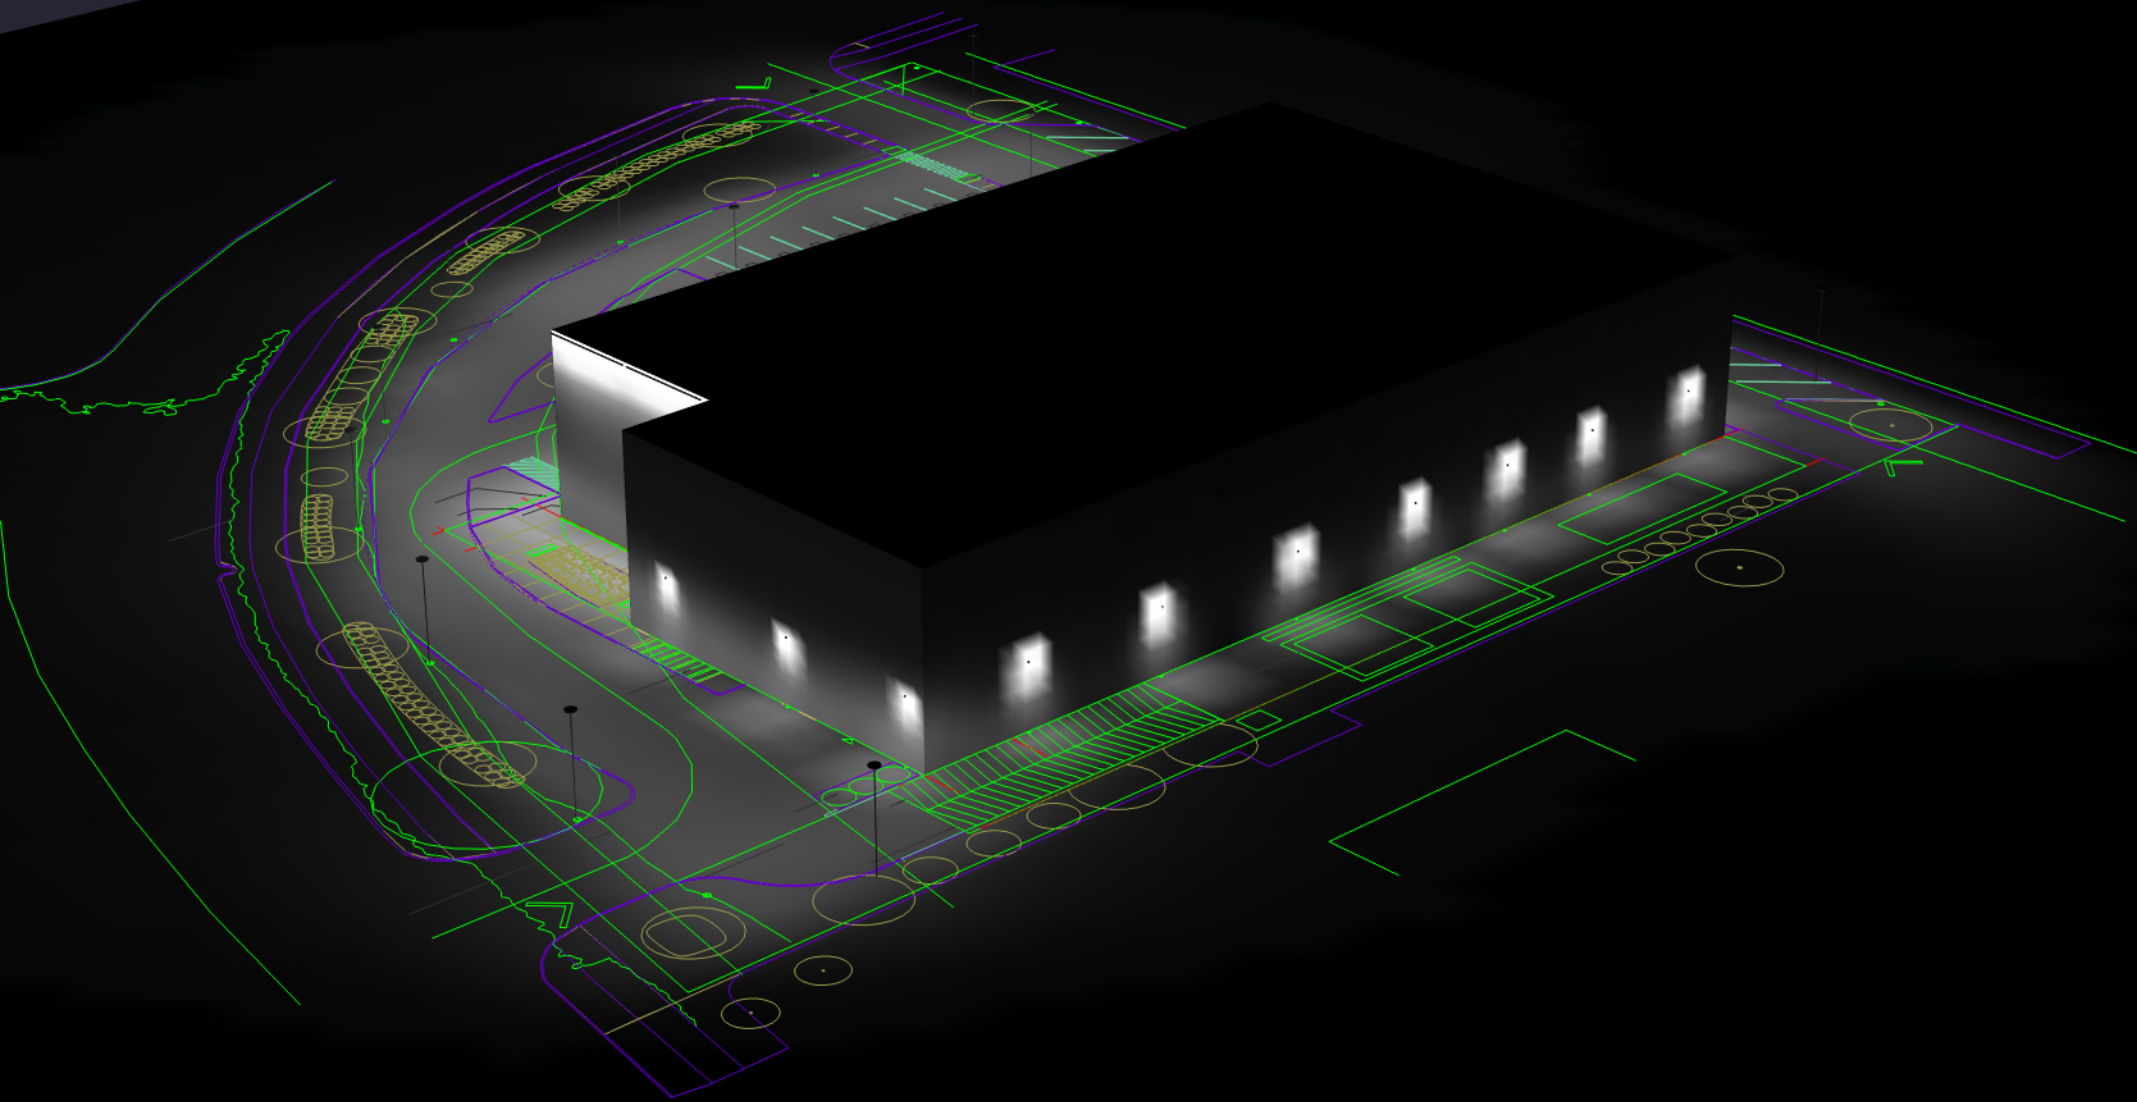

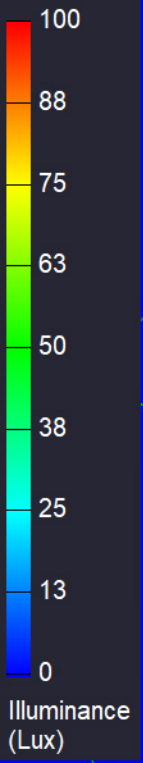

Illuminance
(Lux)

